


TIDE Mass_4

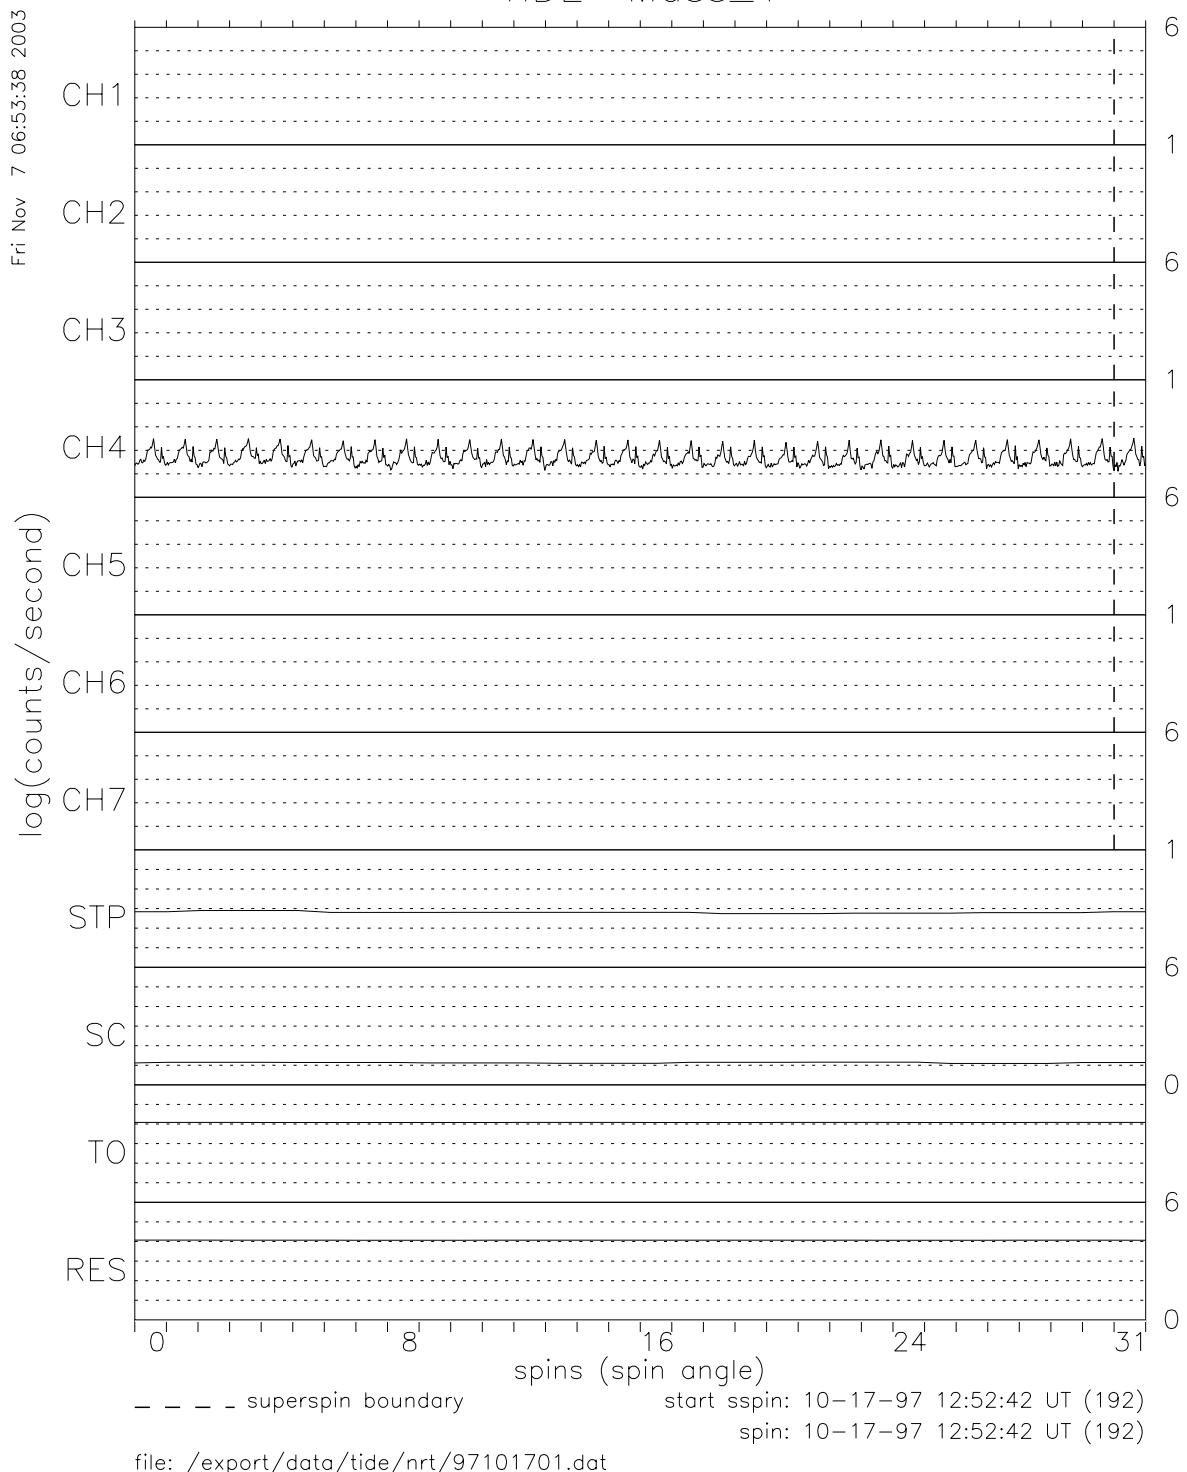

-15kV TOF: -9245 v

-3.6kV MCP: -2593 v

-2.4kV MCP: -1589 v


Input Cur: 294 ma

RPA max: 237 v

Mirror max: 238 v

Fri Nov 7 06:53:38 2003

TIDE Direct Events

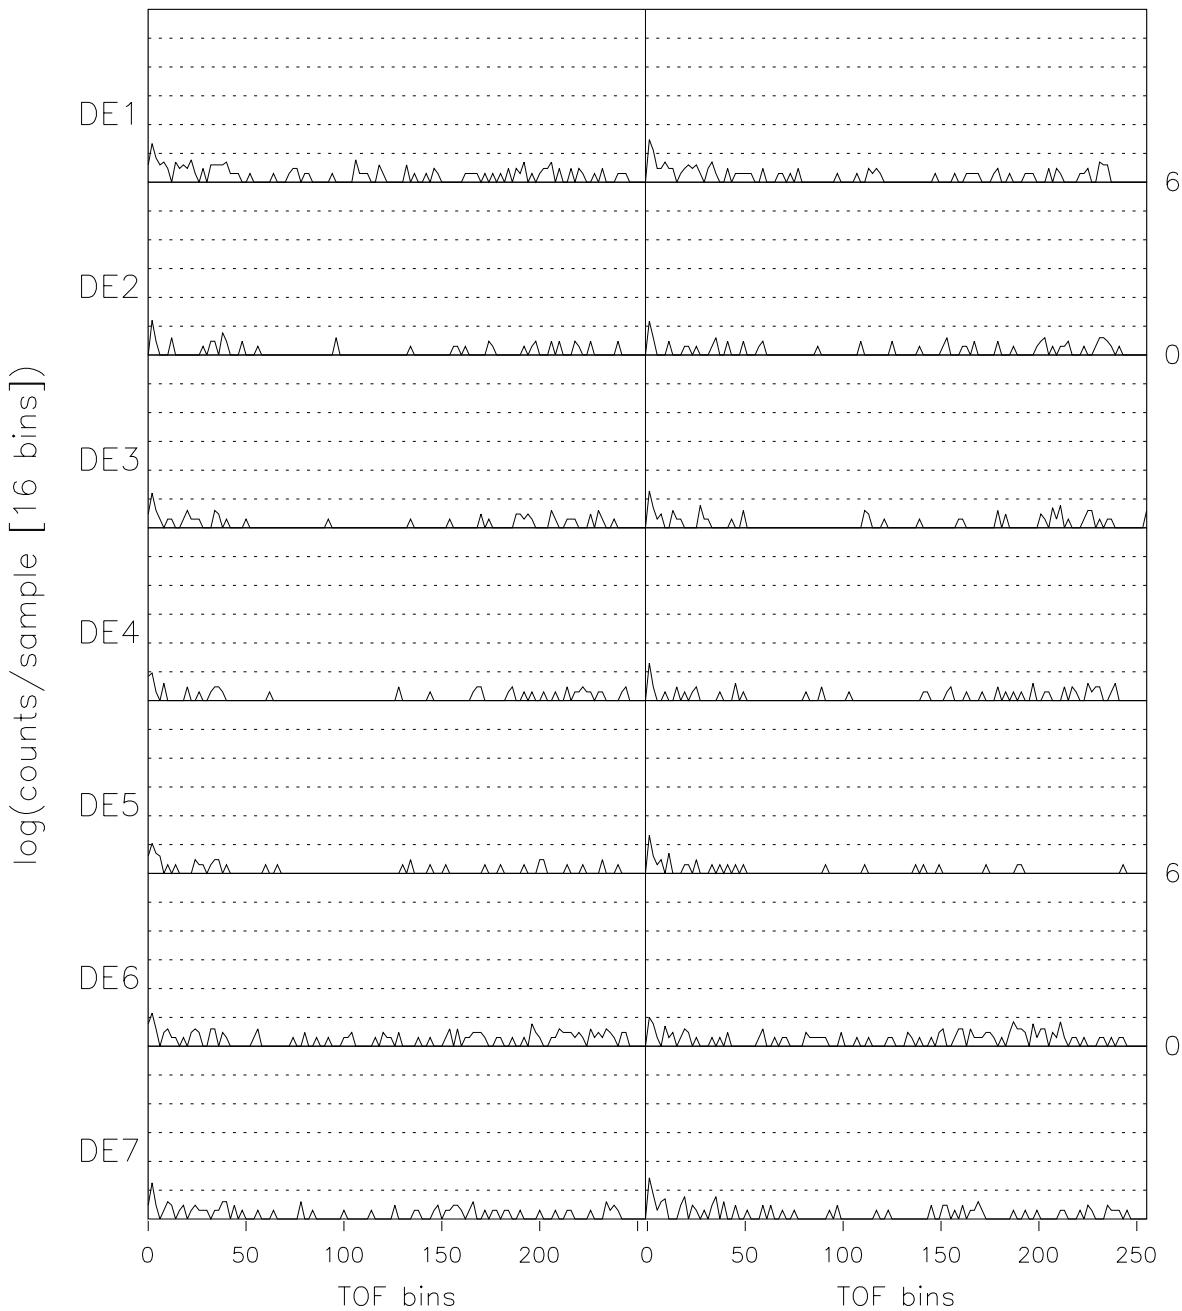

reported: 10-17-97 12:46:12 UT

reported: 10-17-97 12:49:24 UT

file: /export/data/tide/nrt/97101701.dat

-15kV TOF: -9181 v
-3.6kV MCP: -2578 v
-2.4kV MCP: -1579 v
Input Cur: 302 ma
RPA max: 238 v
Mirror max: 238 v